INTER-LABORATORY COLLABORATIVE TEST : MLY/EX FTR

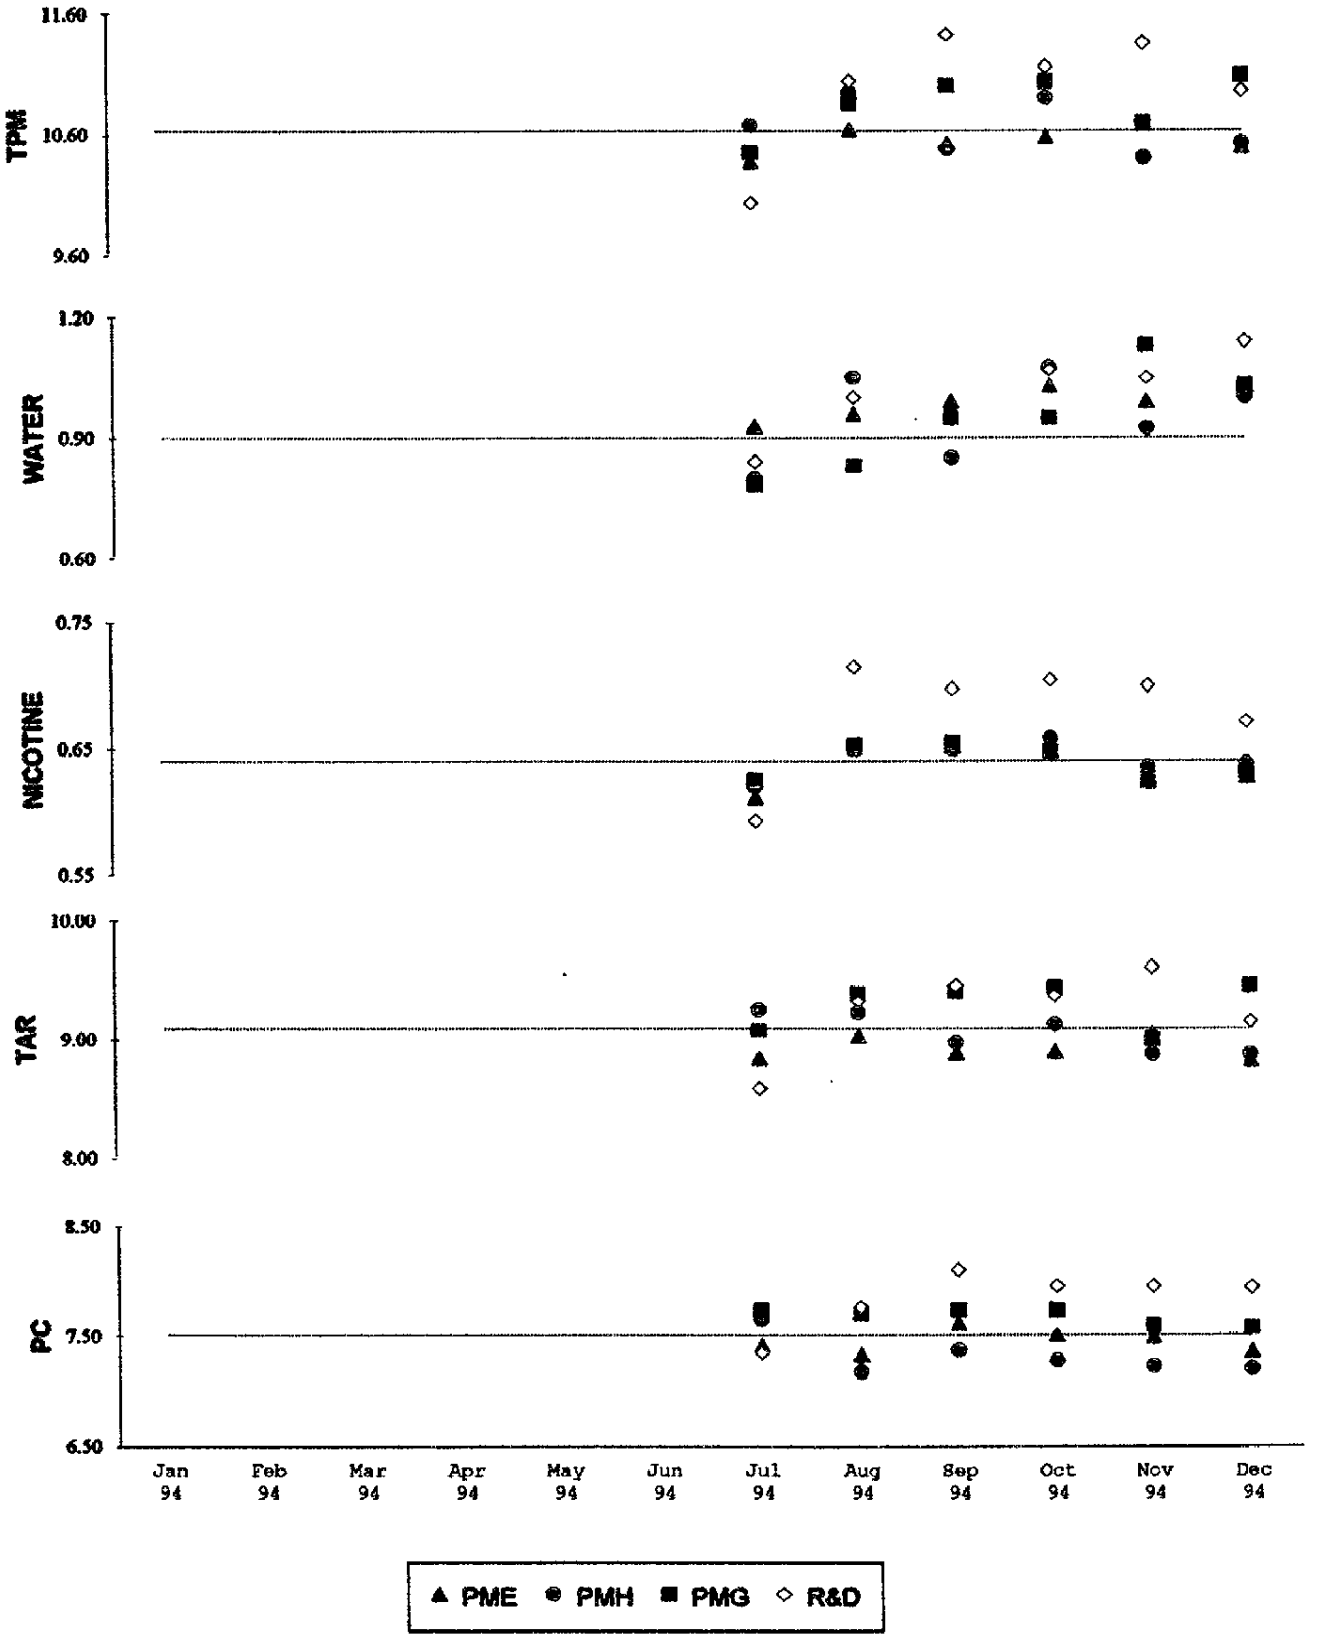

PM3000984812

Source: https://www.industrydocuments.ucsf.edu/docs/ytlk0001